



In-Production Photo Report for Halton Hills Fire Department, ON Job# 43108 : PWO# 33487439

Status as of March 27, 2026

In this report the pump house, tank, and body were merged with the chassis. In the next report your apparatus may continue final assembly.

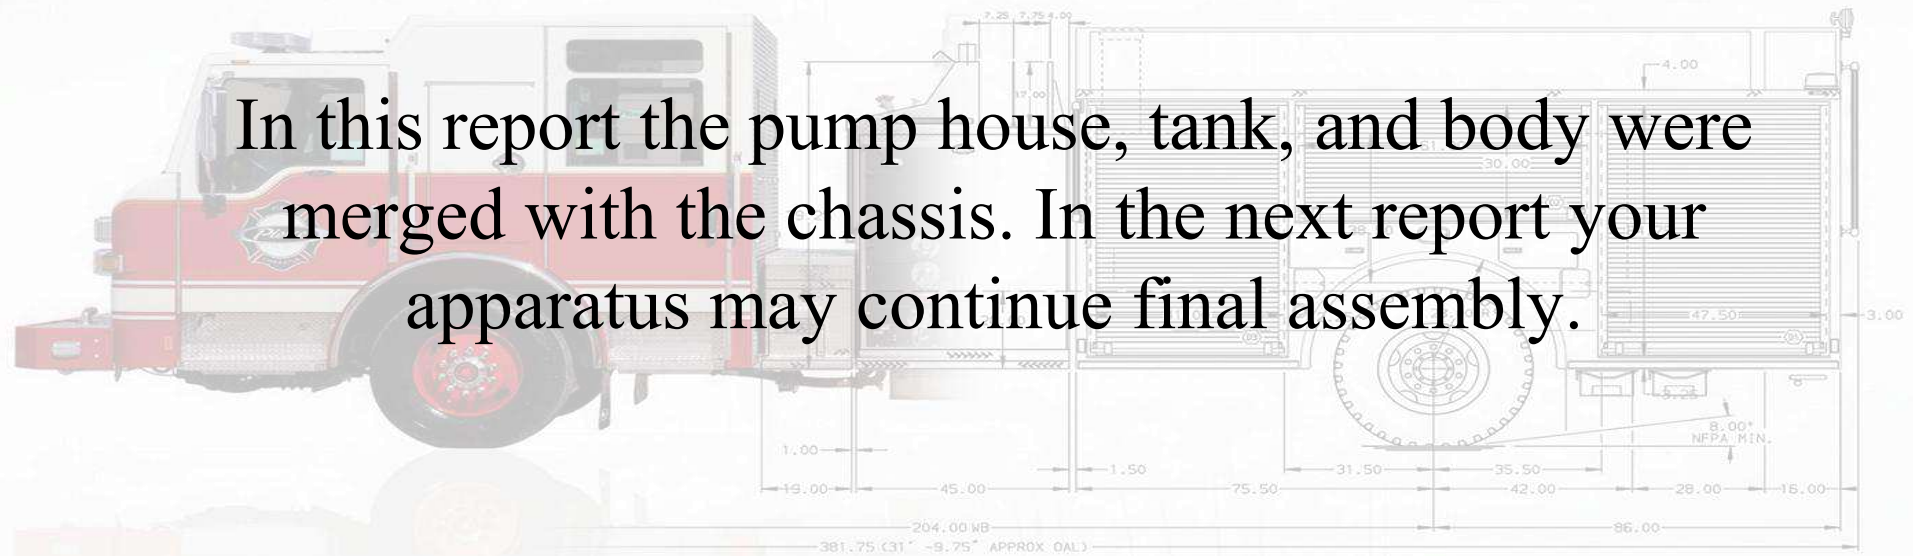


For valued customers of
COMMERCIAL
EMERGENCY EQUIPMENT CO.

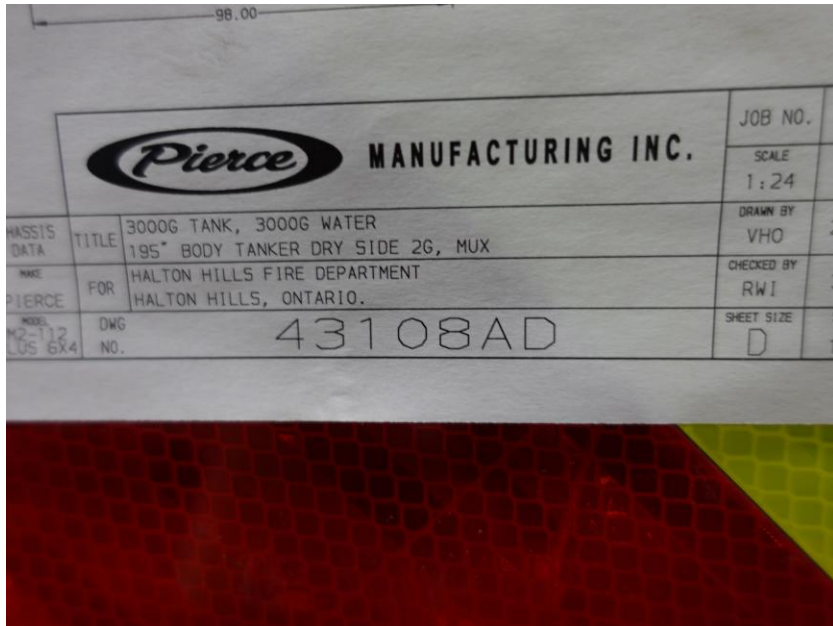

DSC07101



DSC07102

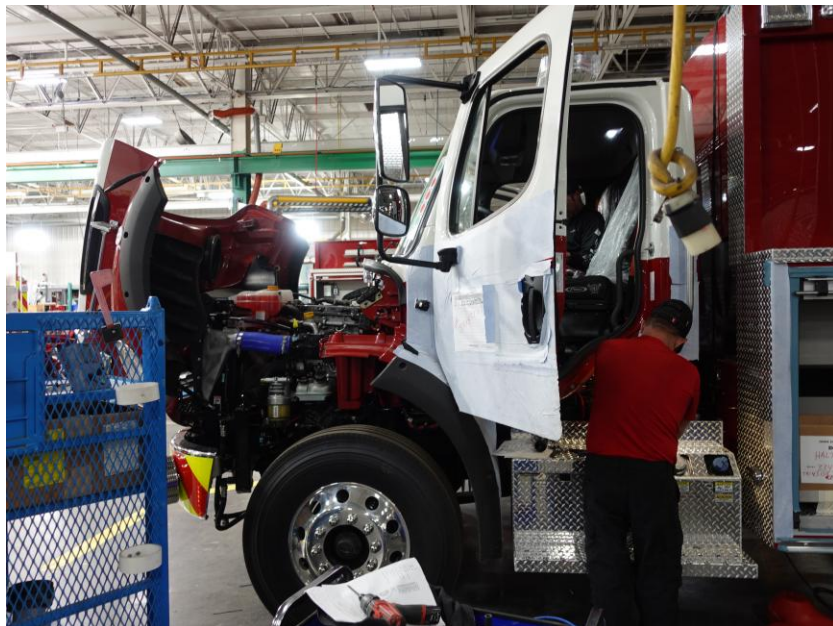

DSC07103




DSC07104



DSC07105



DSC07106

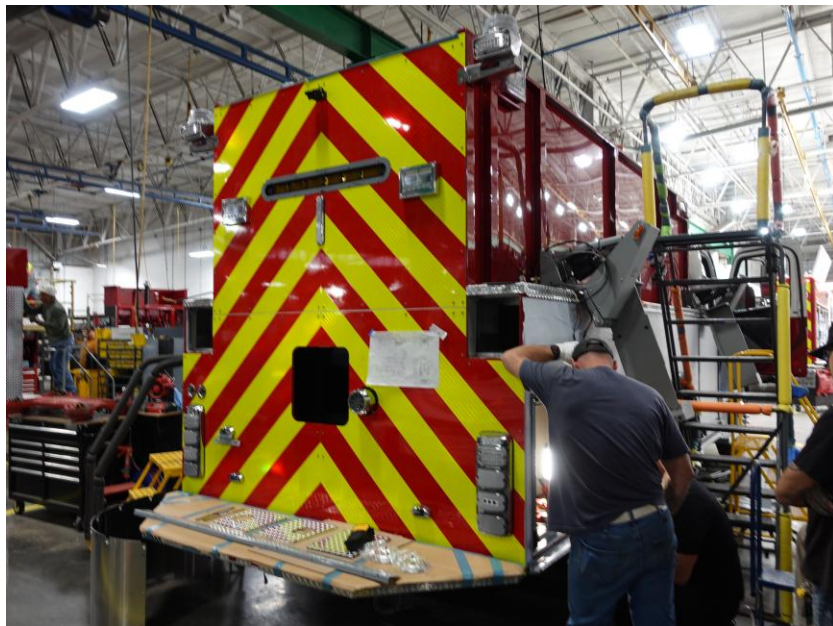

DSC07107



DSC07108



DSC07109



DSC07110